





# Rozvaděč R601

3+N+PE st. 50Hz 400/230V / TN-C-S, In=63A, Ik" = max.10 kA

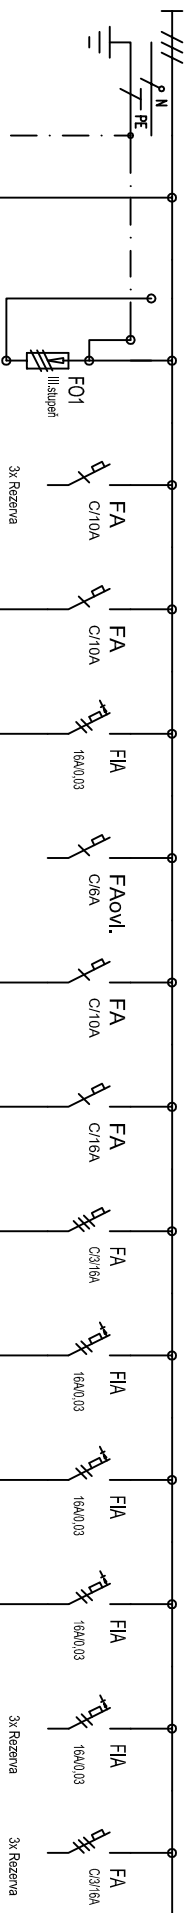


FAx  
C/32A



XTL  
1-3

výkon kW	25	PE
kabel	CYK-L 4x16	CYA 25mm <sup>2</sup>
m.č.	6.NP	6.NP



0,7	2,0	0,7	0,1	0,04	3	2,0	2,0	2,0	2,0	2,0
CYK-L 3x1,5	CYK-L 3x2,5	CYK-L 3x1,5	CYK-L 3x1,5	CYK-L 3x2,5	CYK-L 5x2,5	CYK-L 3x2,5	CYK-L 3x2,5	CYK-L 3x2,5	CYK-L 3x2,5	CYK-L 3x2,5
606,607	606,607	607	607	607	607	606	606	606	606	606



Ventilátor serverový Otep.čerp. 80W/230V

Vypracoval:	Ing. Miroslav Fráns	AKCE:	OSSZ Trutnov - rekonstrukce budovy "A"	Investor:	Česká republika - OSSZ	Zak. číslo:	TO-426-DPS	A.K.:		Lístů:	2
Kontroloval:	Ing. Martin Uličný			Obsah:		Změna/Datum:		V.č.:			
Datum :	10/2013			Schéma R601		Měřtko:	N		D.1.4.7.b.17.	Líst:	2